

# Sound Insulation

According to  
ISO 140/3

# A5

Authorizing Company: ETEM S.A.

Dimensions in mm

## Specimen description:

Single sash side/bottom hung  
aluminium window E-1000 series

Area : 1,9 m<sup>2</sup>



Total glazing thickness: 22 mm

## Layers:

Thermal insulating glazing  
6+12+4 mm

Two rubber seals between  
sash frame and glazing

Three rubber seals between  
sash and frame

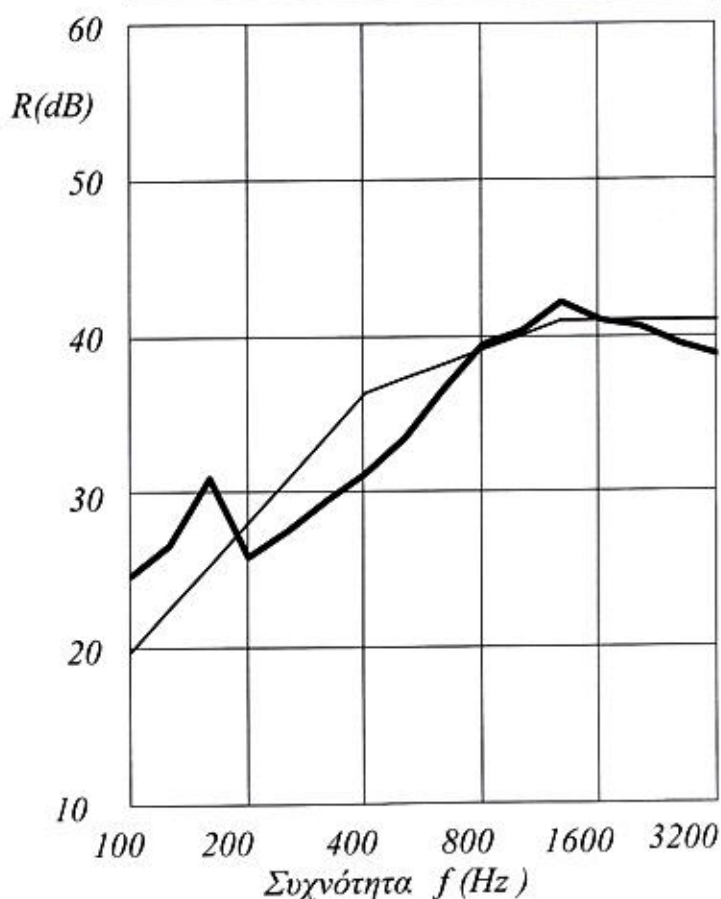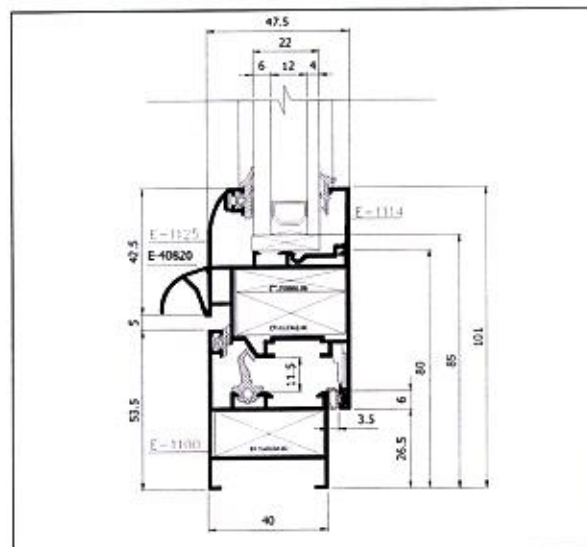

## Test rooms:

### Volumes:

V source = 29,7 m<sup>3</sup>

V receiving = 43,8 m<sup>3</sup>

Type of room : Laboratory test room

Room condition: Empty

Excitation : White noise

Filter : 1/3 octave

Evaluation according to ISO 717/1

Weighted Sound Reduction Index

**R<sub>w</sub> = 38 dB**

f(Hz): 100 125 160 200 250 315 400 500 630 800 1000 1250 1600 2000 2500 3150  
R(dB): 24,3 26,4 31,1 25,6 27,4 29,5 31,4 33,8 37,2 40,3 41,3 43,3 42,0 41,6 40,3 39,5

Test number: **A5.346.04**

Date of test: 23.04.2004 C

School of Architecture - Faculty of Technology - A.U.T.

Architectural Technology Laboratory

Director: E.Tzekakis

Signature